


7' OF 4" PERFORATED PVC.
ADJUST ALIGNMENT AS NEEDED.

12" X 12" X 6" DEEP
DRAINAGE SUMP

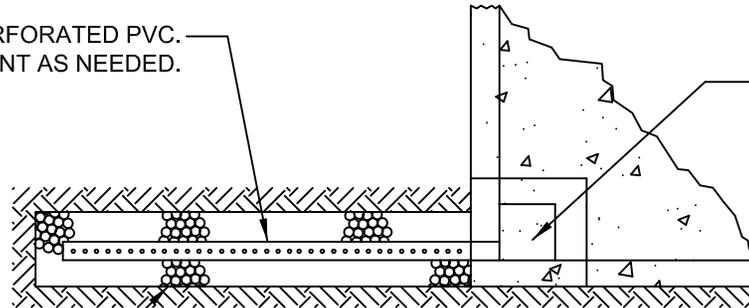


SEE UNDERDRAIN DETAIL FOR
ROCK AND GEOTEXTILE
FABRIC REQUIREMENTS


PLAN VIEW

4" PVC AT 1% SLOPE IN ACCORDANCE
WITH CITY OF TYLER STANDARD
SPECIFICATION FOR CONCRETE VAULTS

SLOPE TO DRAIN 1%

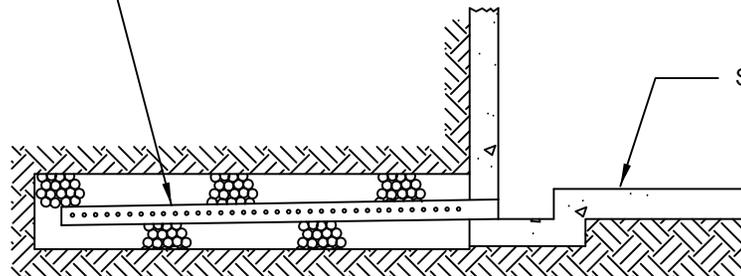

PROFILE VIEW



CITY OF TYLER
STANDARD DETAIL

CONCRETE VAULT
FIELD LINE

APPROVED: *Asa Crum*
UTILITIES ENGINEER

REVISION DATE: 8/2/11